
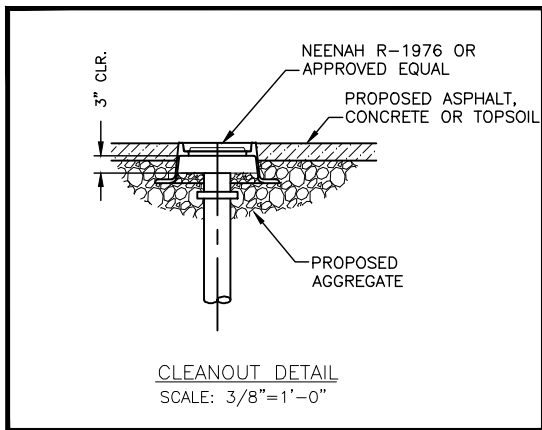


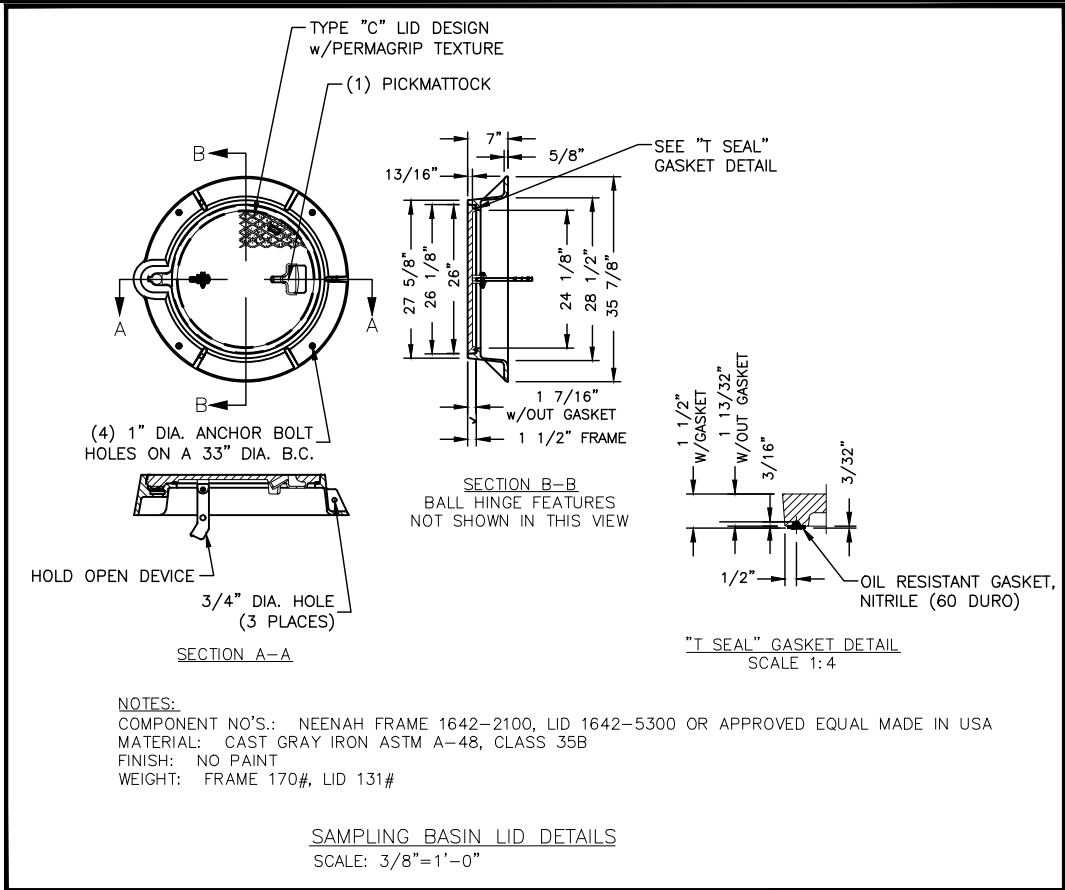

GREASE TRAP NOTES:


- GREASE TRAP SIZE SHALL BE 15% OF DAILY CAPACITY, OR A MINIMUM OF 1000 GALS. OR AS DIRECTED BY PORTAGE COUNTY WATER RESOURCES.
- ALL WALLS, TOP, & BOTTOM OF TANK SHALL BE STEEL REINFORCED, ASTM 615 & ASTM 497, GRADE 40, CONCRETE CLASS "C".
- ALL 6" PVC PIPING SHALL BE SDR-35 PVC WITH GASKETED JOINTS.
- JOINTS TO MEET ASTM C-443, OR SHALL BE WATERTIGHT MASTIC JOINT.
- NO STEPS ARE TO BE INSTALLED.
- GREASE TRAPS TO BE VENTED IN ACCORDANCE WITH CHAPTER 10 SECTION 1003 OF THE OHIO PLUMBING CODE.
- ACCESS OPENINGS SHALL BE CENTERED OVER INLET/OUTLET PIPES TO ALLOW DIRECT ACCESS FROM ABOVE.
- GREASE TRAP SHALL BE INSPECTED BY THE PORTAGE COUNTY WATER RESOURCES DEPARTMENT PRIOR TO UNLOADING.
- GREASE TRAP FROM MANUFACTURER NOT PREAPPROVED. MUST BE APPROVED BY PORTAGE COUNTY WATER RESOURCES IN WRITING. COMPLETE DRAWING SUBMITTAL REQUIRED.

SAMPLING BASIN NOTES:

- 2' x 2' SQUARE SAMPLING BASIN

APPROVED GREASE TRAP & SAMPLING BASIN SUPPLIERS:

- | | |
|----------------------------|----------------|
| 1. LINDSEY CONCRETE | 1-800-837-7788 |
| 2. MACK INDUSTRIES INC. | 330-483-3111 |
| 3. PORTAGE SEPTIC TANK CO. | 330-673-7892 |
| 4. MIGHELBRINK INC. | 330-699-2812 |

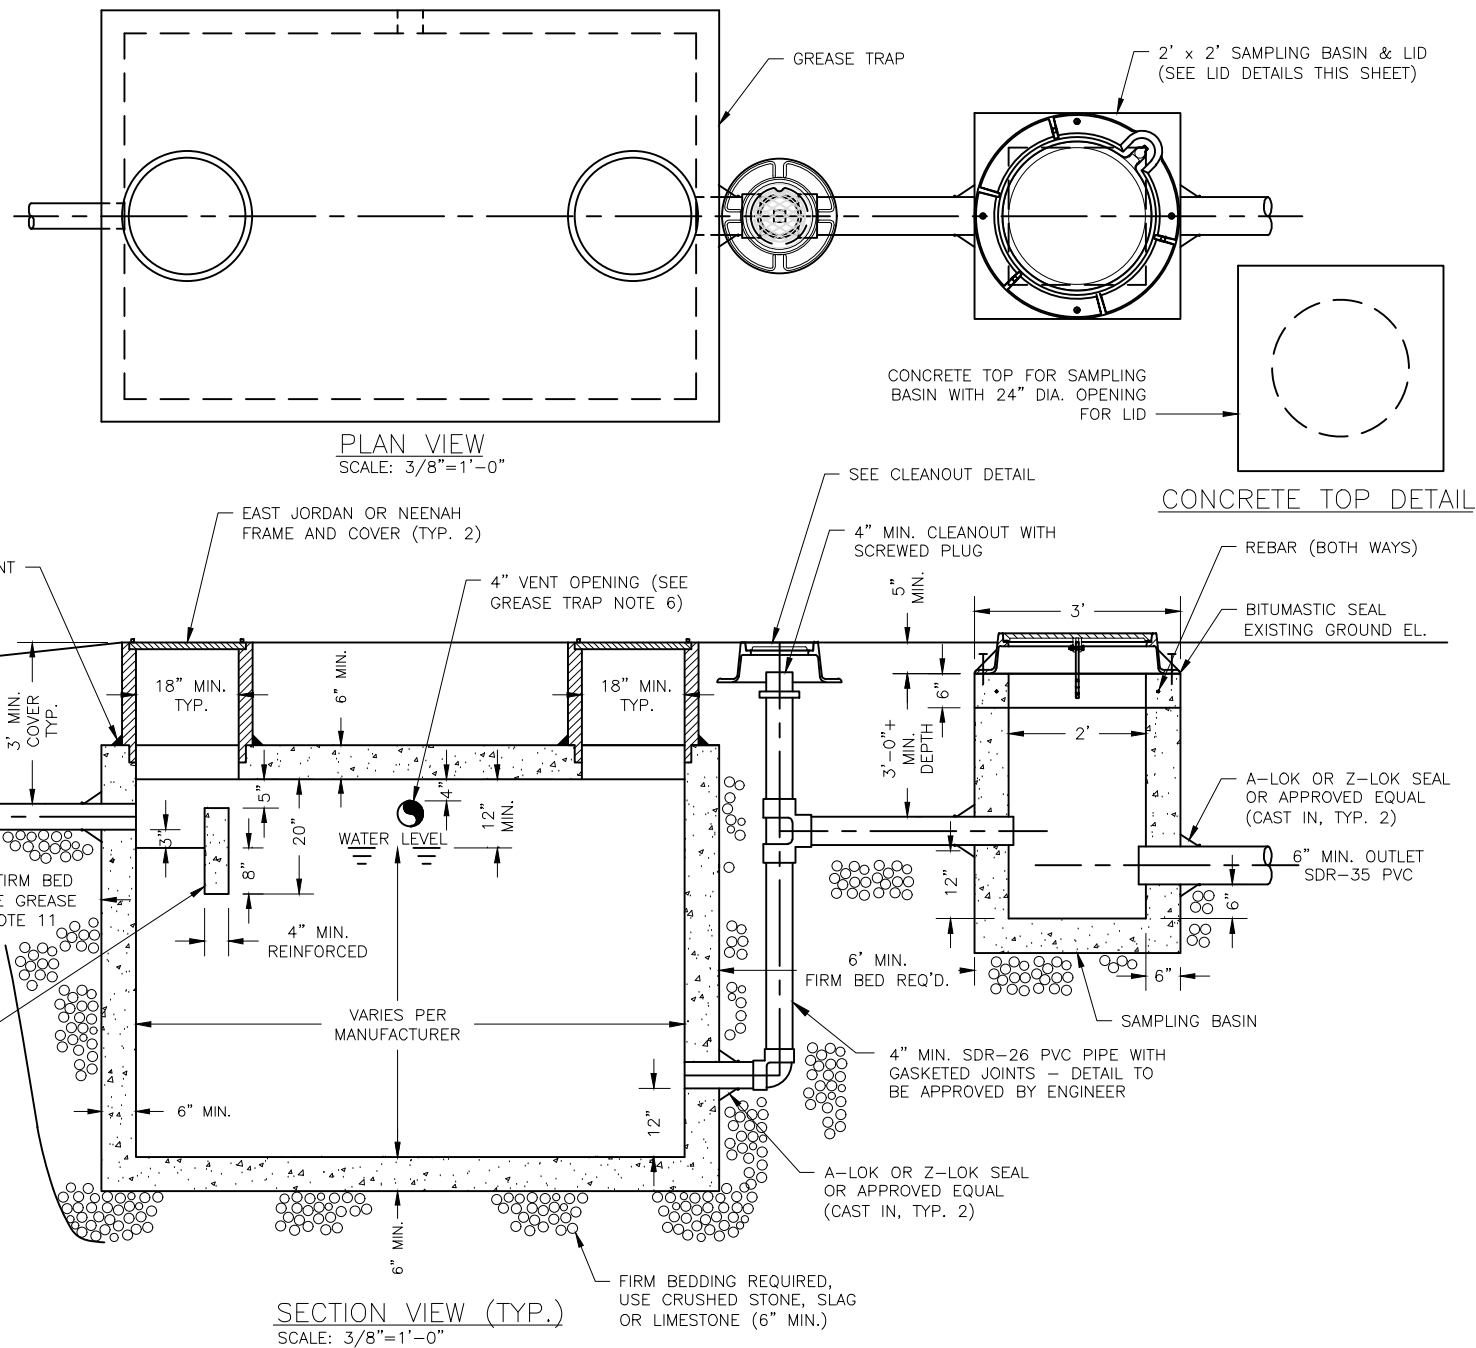

STANDARD GREASE/OIL TRAP

TRAFFIC BEARING - 1,000 GALLON MINIMUM SIZE

PORTAGE COUNTY WATER RESOURCES

8116 INFIRMARY ROAD
RAVENNA, OHIO 44266

DATE: 10-5-17	SCALE: 3/8"=1'-0"	DRAWN: JGE	APPROVED:
------------------	----------------------	---------------	-----------